


Elevation

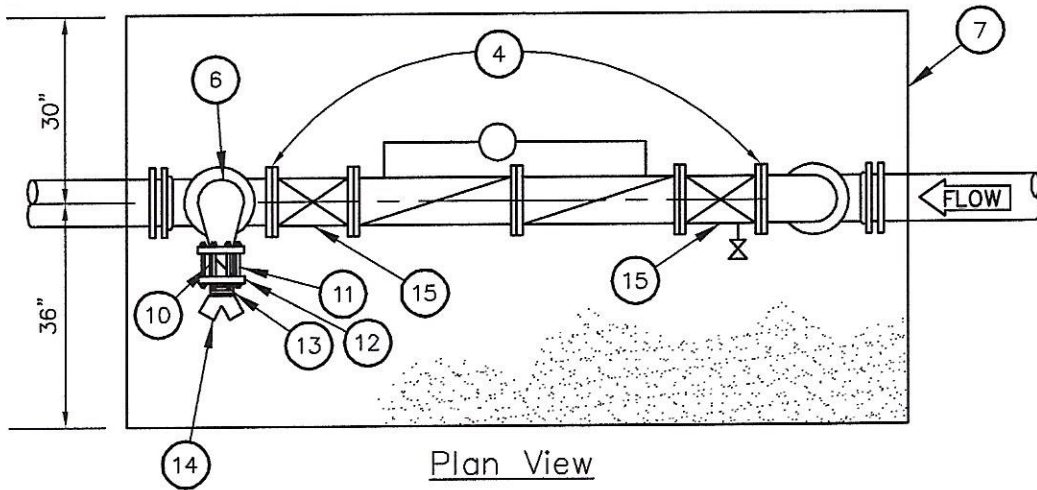

Plan View


<b>REVISED</b> DATE _____ _____ _____ _____	<b>CITY OF COMPTON</b> PUBLIC WORKS DEPARTMENT - WATER UTILITY DIVISION	DRAWN <u>L.H.O.</u> DATE <u>8-25-15</u>
	<b>FIRELINE</b> <b>DOUBLE CHECK DETECTOR ASSEMBLY</b>	<b>STD. NO.</b> <u>721</u>
	APPROVED <u><i>[Signature]</i></u> DATE <u>9.1.15</u> DIRECTOR OF PUBLIC WORKS AND MUNICIPAL UTILITIES	1 of 2

## List of Materials

Item	Description
1	90° D.I. elbow, FLG.
2	D.I.P spool, class 53, FLG. (order to size).
3	90° compact D.I. elbow, FLG.
4	Double detector check assembly.
5	Compact D.I Tee, FLG.
6	Pipe size X 4" - 90° D.I. required elbow, FLG. (see Note 3 hereon).
7	Concrete pad, class 520-C-2500
8	Insert compact D.I. tee for combination fire line and domestic service.
9	1/8" full face cloth inserted rubber flange gasket.
The following items must have final approval and inspection by Fire Marshal.	
10	4" UL/FM wafer rubber-seated check valve.
11	8-5/8" X 7" L threaded-studs with 16 nuts, plain.
12	4" X 9" C.I threaded companion flange.
13	4" X 4" L galvanized nipple, I.P.T.
14	4" X (2) 2-1/2" Y bronze-straight pattern fire dept. connection (FDC) with plastic caps.
15	Tamper switch.
16	Owner's chain and breakaway padlock(s).

### Notes:

1. See Section 3 of these Specifications for approved manufacturers of double detector check assemblies and required pressure principle detector assemblies by-pass meters, testing requirements, locations of assemblies and other requirements.  
  
The detector (by-pass) meter shall be 5/8" or 3/4" normal size with bronze main case and bottom plate and shall have a straight read magnetic driven register capable of detecting consumptive use in cubic foot increments.
2. See Section 5-10 of these Specifications for fire line assembly painting requirements.
3. All bolts and nuts except item 11 on sheet 1 are to be zinc plated (brass is not acceptable).
4. Contractor shall submit to Engineer for approval the proposed location of fire line assembly prior to construction. Assembly shall be visible from street and within 50 feet of an area accessible by fire department vehicles.
5. Fire line assembly installed in easements road and streets without curbs or with rolled curbs shall be protected by guard posts per Standard Drawing 615. The number and specific location of such posts will be determined by the Engineer if not shown on the plans.
6. See Section 5-03.04 of these Specifications for polyethylene protective wrapping requirements.
7. New or updated signage may be required by fire department.

<b>REVISED</b> DATE _____ _____ _____ _____	<b>CITY OF COMPTON</b> PUBLIC WORKS DEPARTMENT - WATER UTILITY DIVISION	DRAWN <u>L.H.O.</u> DATE <u>8-25-15</u>	
	<b>FIRELINE</b> <b>DOUBLE CHECK DETECTOR ASSEMBLY</b>		
	APPROVED 	DATE <u>9.1.15</u>	<b>STD. NO.</b> <u>721</u> 2 of 2
	DIRECTOR OF PUBLIC WORKS AND MUNICIPAL UTILITIES		